


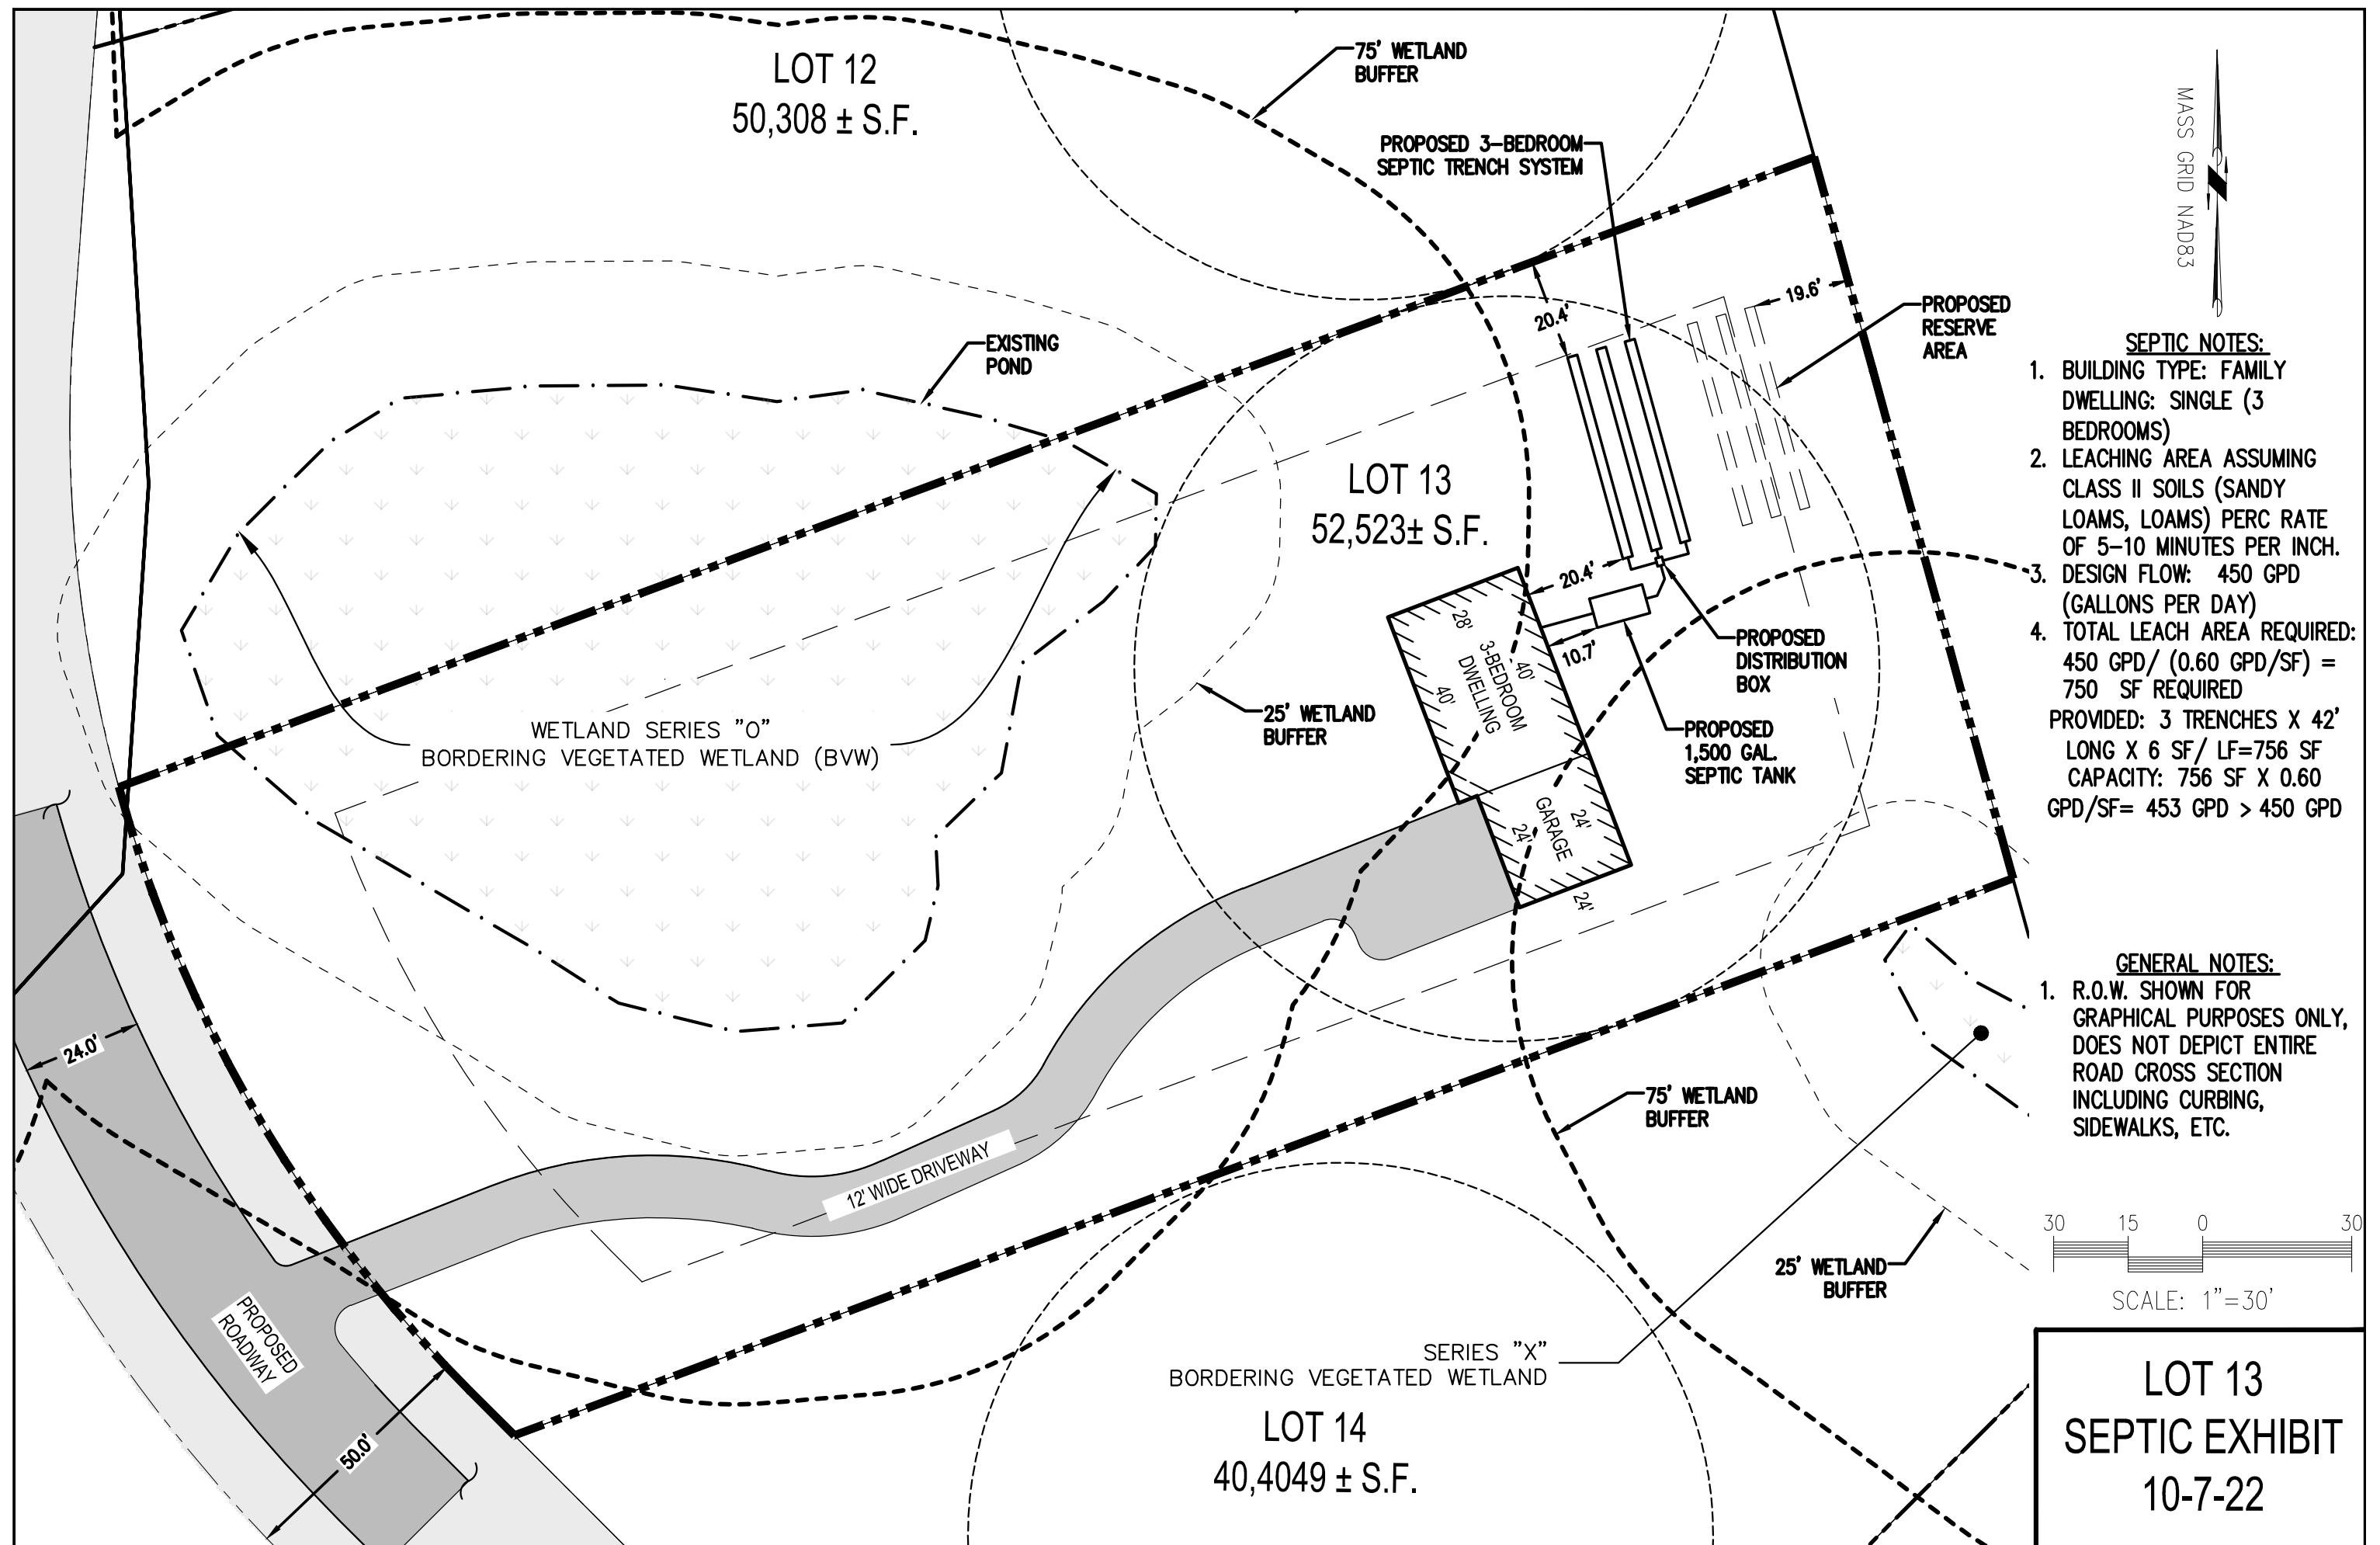


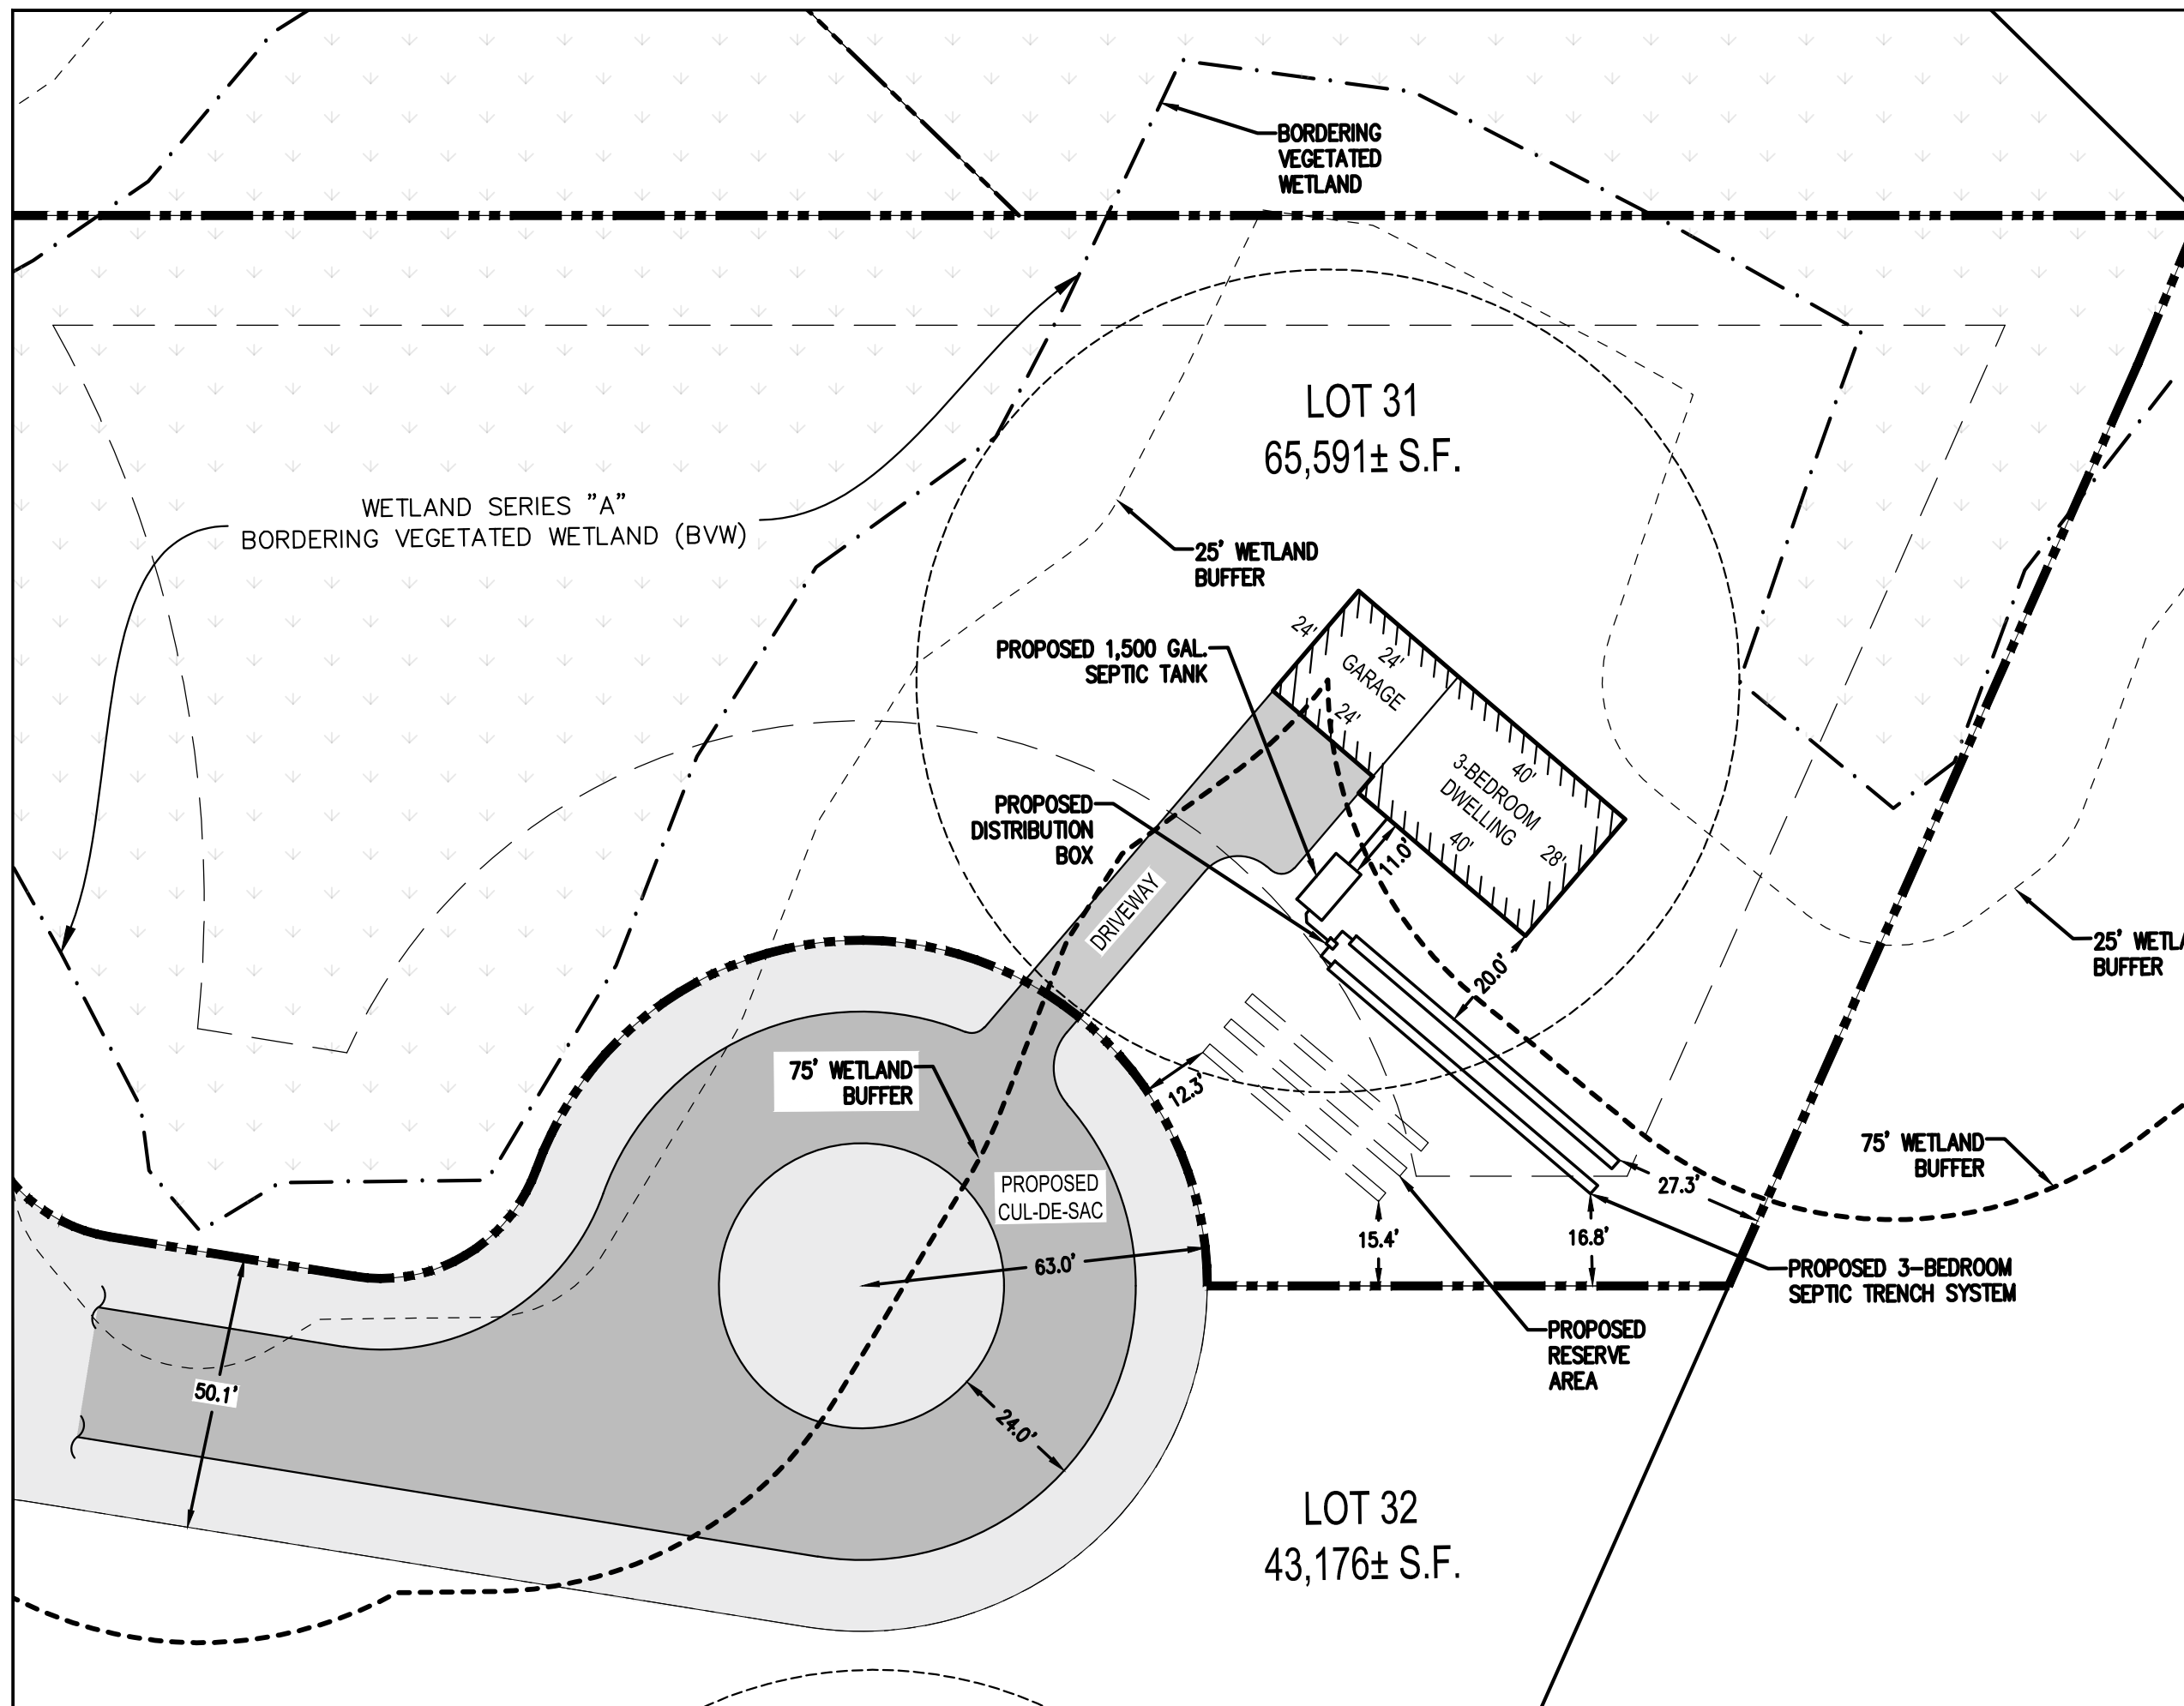

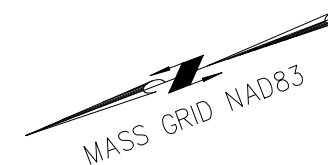


- SEPTIC NOTES:**
1. BUILDING TYPE: FAMILY DWELLING: SINGLE (3 BEDROOMS)
 2. LEACHING AREA ASSUMING CLASS II SOILS (SANDY LOAMS, LOAMS) PERC RATE OF 5-10 MINUTES PER INCH.
 3. DESIGN FLOW: 450 GPD (GALLONS PER DAY)
 4. TOTAL LEACH AREA REQUIRED: 450 GPD / (0.60 GPD/SF) = 750 SF REQUIRED
PROVIDED: 2 TRENCHES X 63' LONG X 6 SF / LF=756 SF
CAPACITY: 756 SF X 0.60 GPD/SF= 453 GPD > 450 GPD

- GENERAL NOTES:**
1. R.O.W. SHOWN FOR GRAPHICAL PURPOSES ONLY, DOES NOT DEPICT ENTIRE ROAD CROSS SECTION INCLUDING CURBING, SIDEWALKS, ETC.

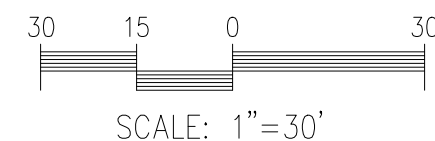

LOT 31
SEPTIC EXHIBIT
10-7-22

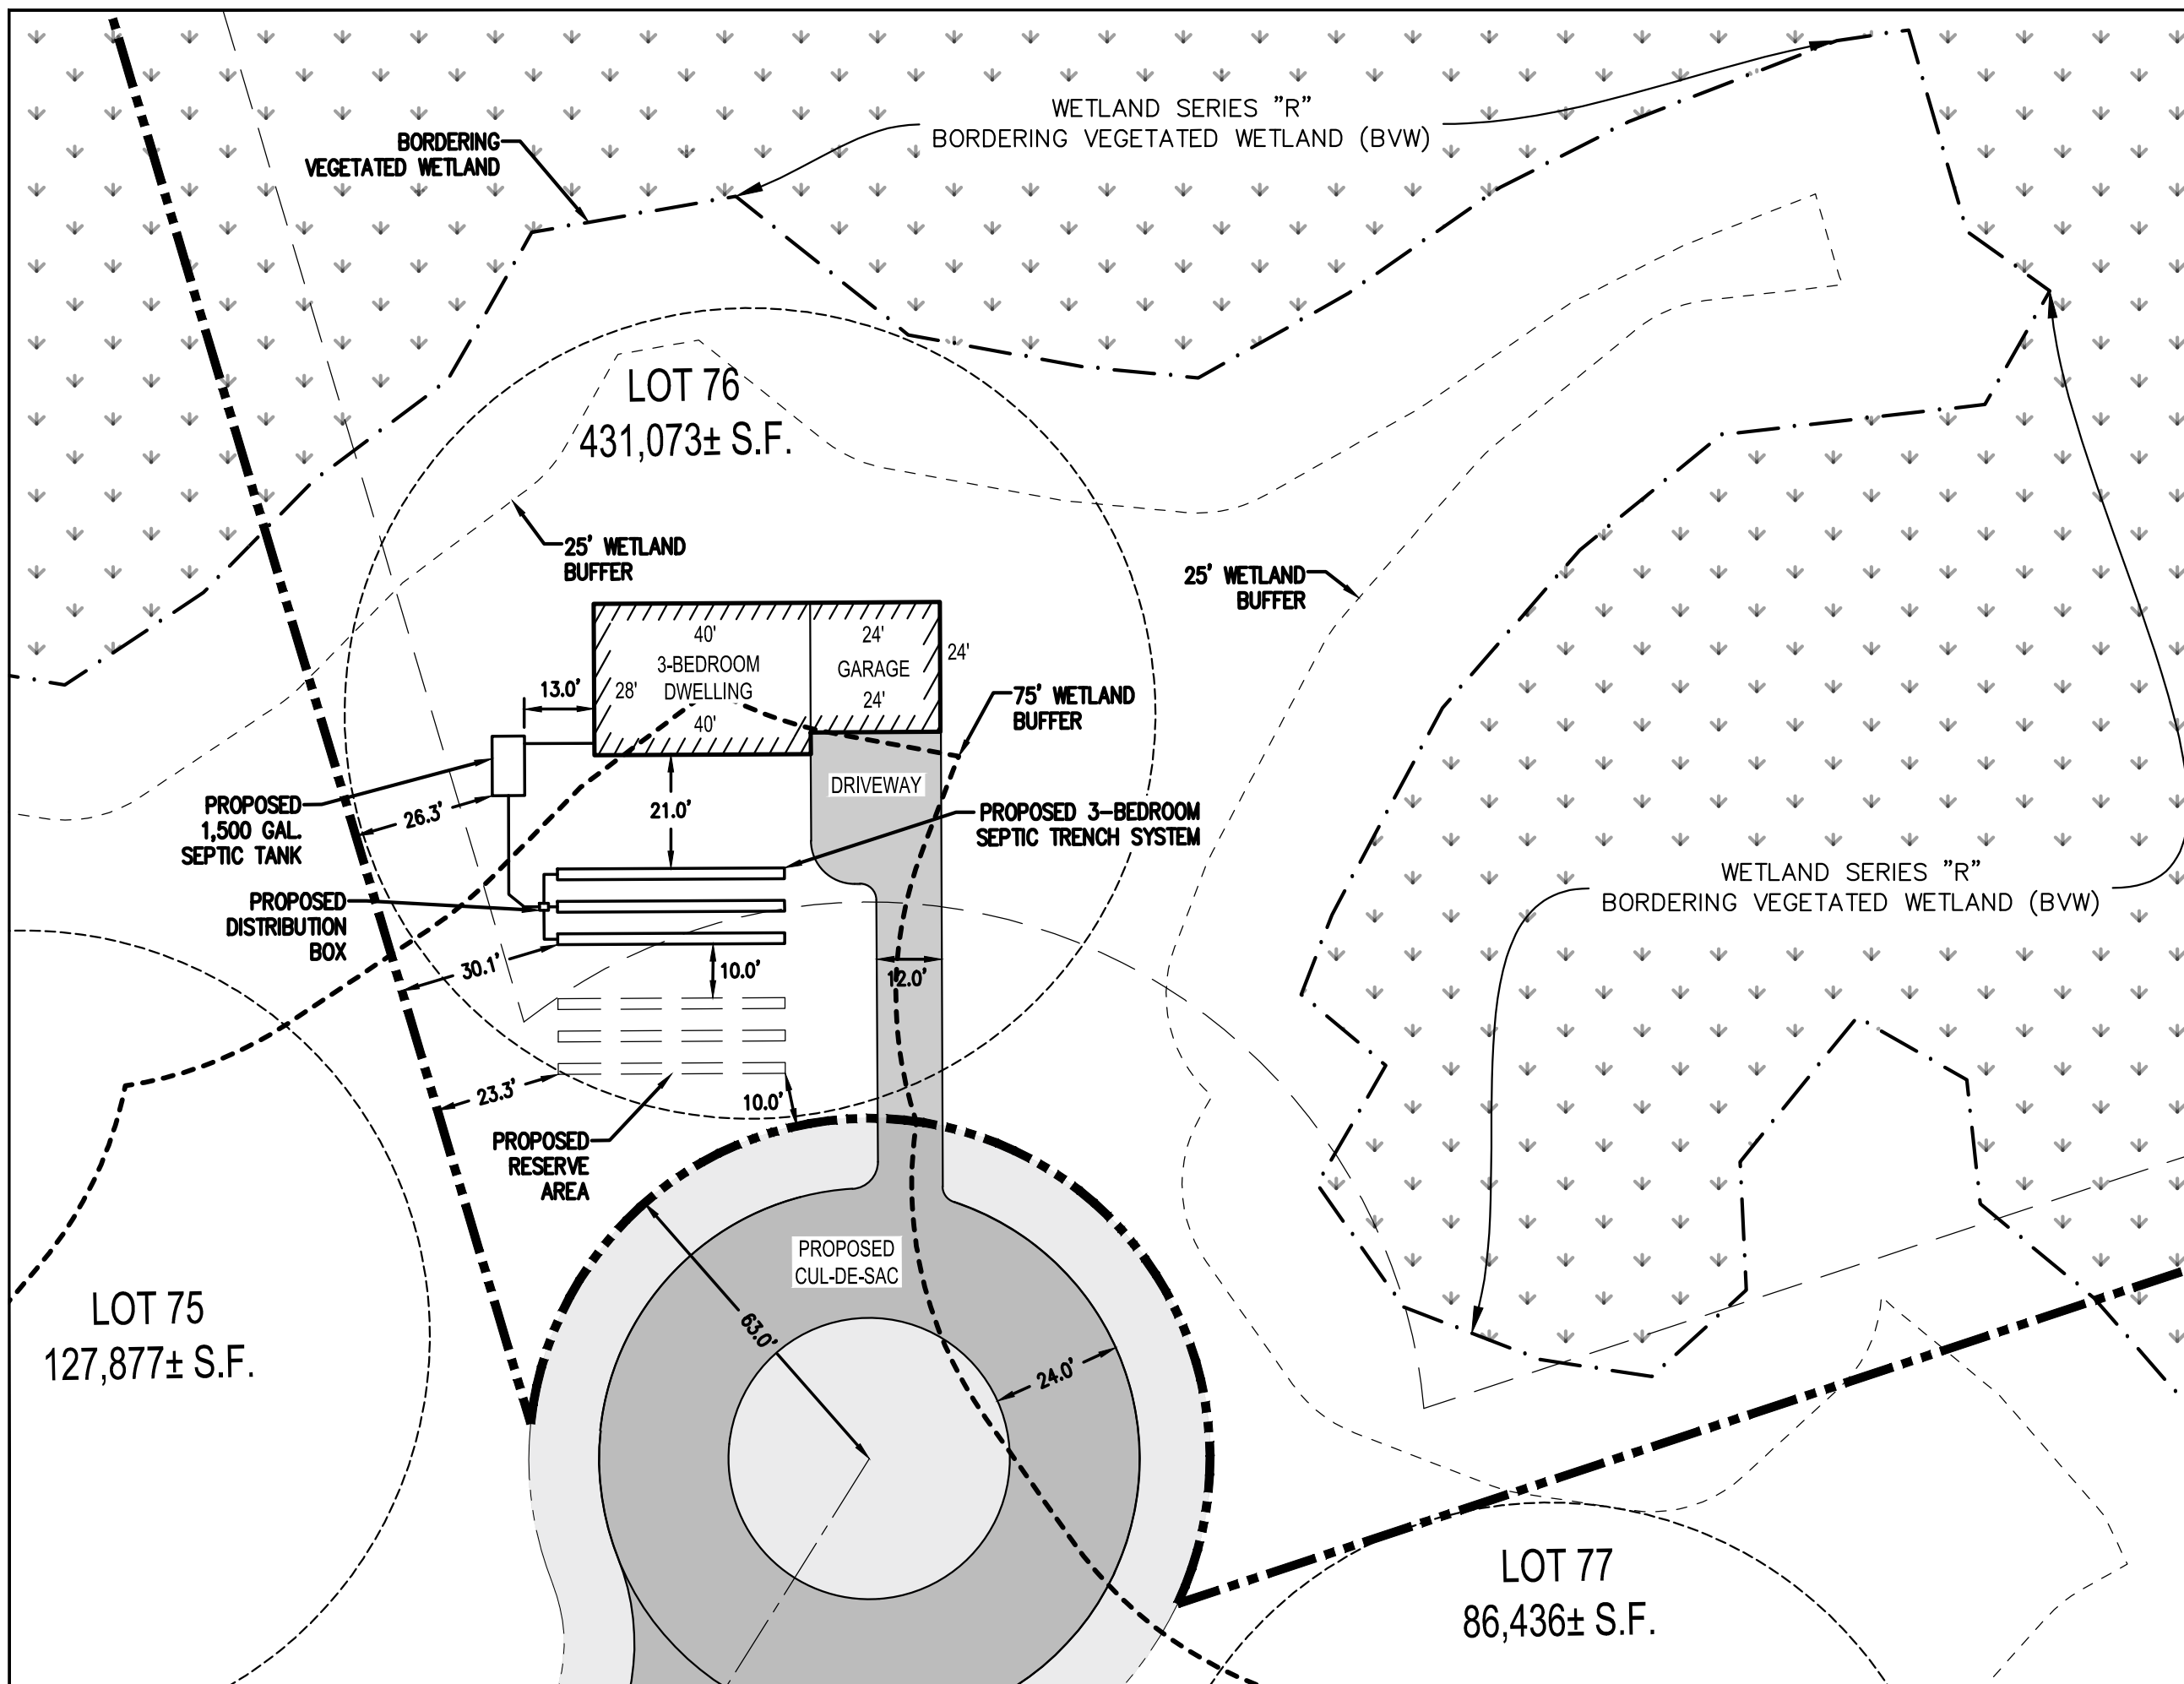

SEPTIC NOTES:

1. BUILDING TYPE: FAMILY DWELLING: SINGLE (3 BEDROOMS)
2. LEACHING AREA ASSUMING CLASS II SOILS (SANDY LOAMS, LOAMS) PERC RATE OF 5-10 MINUTES PER INCH.
3. DESIGN FLOW: 450 GPD (GALLONS PER DAY)
4. TOTAL LEACH AREA REQUIRED: 450 GPD / (0.60 GPD/SF) = 750 SF REQUIRED
PROVIDED: 3 TRENCHES X 42' LONG X 6 SF / LF=756 SF
CAPACITY: 756 SF X 0.60 GPD/SF= 453 GPD > 450 GPD

GENERAL NOTES:

1. R.O.W. SHOWN FOR GRAPHICAL PURPOSES ONLY, DOES NOT DEPICT ENTIRE ROAD CROSS SECTION INCLUDING CURBING, SIDEWALKS, ETC.



**LOT 76
SEPTIC EXHIBIT
10-7-22**

